





The diagram illustrates a 10 kV busbar system with two busbars, Bбод 1 and Bбод 2. Each busbar has four outgoing lines (1L1, 1L2, 1L3, N for Bбод 1; 2L1, 2L2, 2L3, N for Bбод 2). The lines are connected to circuit breakers QF1 and QF2, which are controlled by a central control system (схема управления). The busbars are connected to a transformer (KV1, KV2) and a load (НАГРУЗКА).

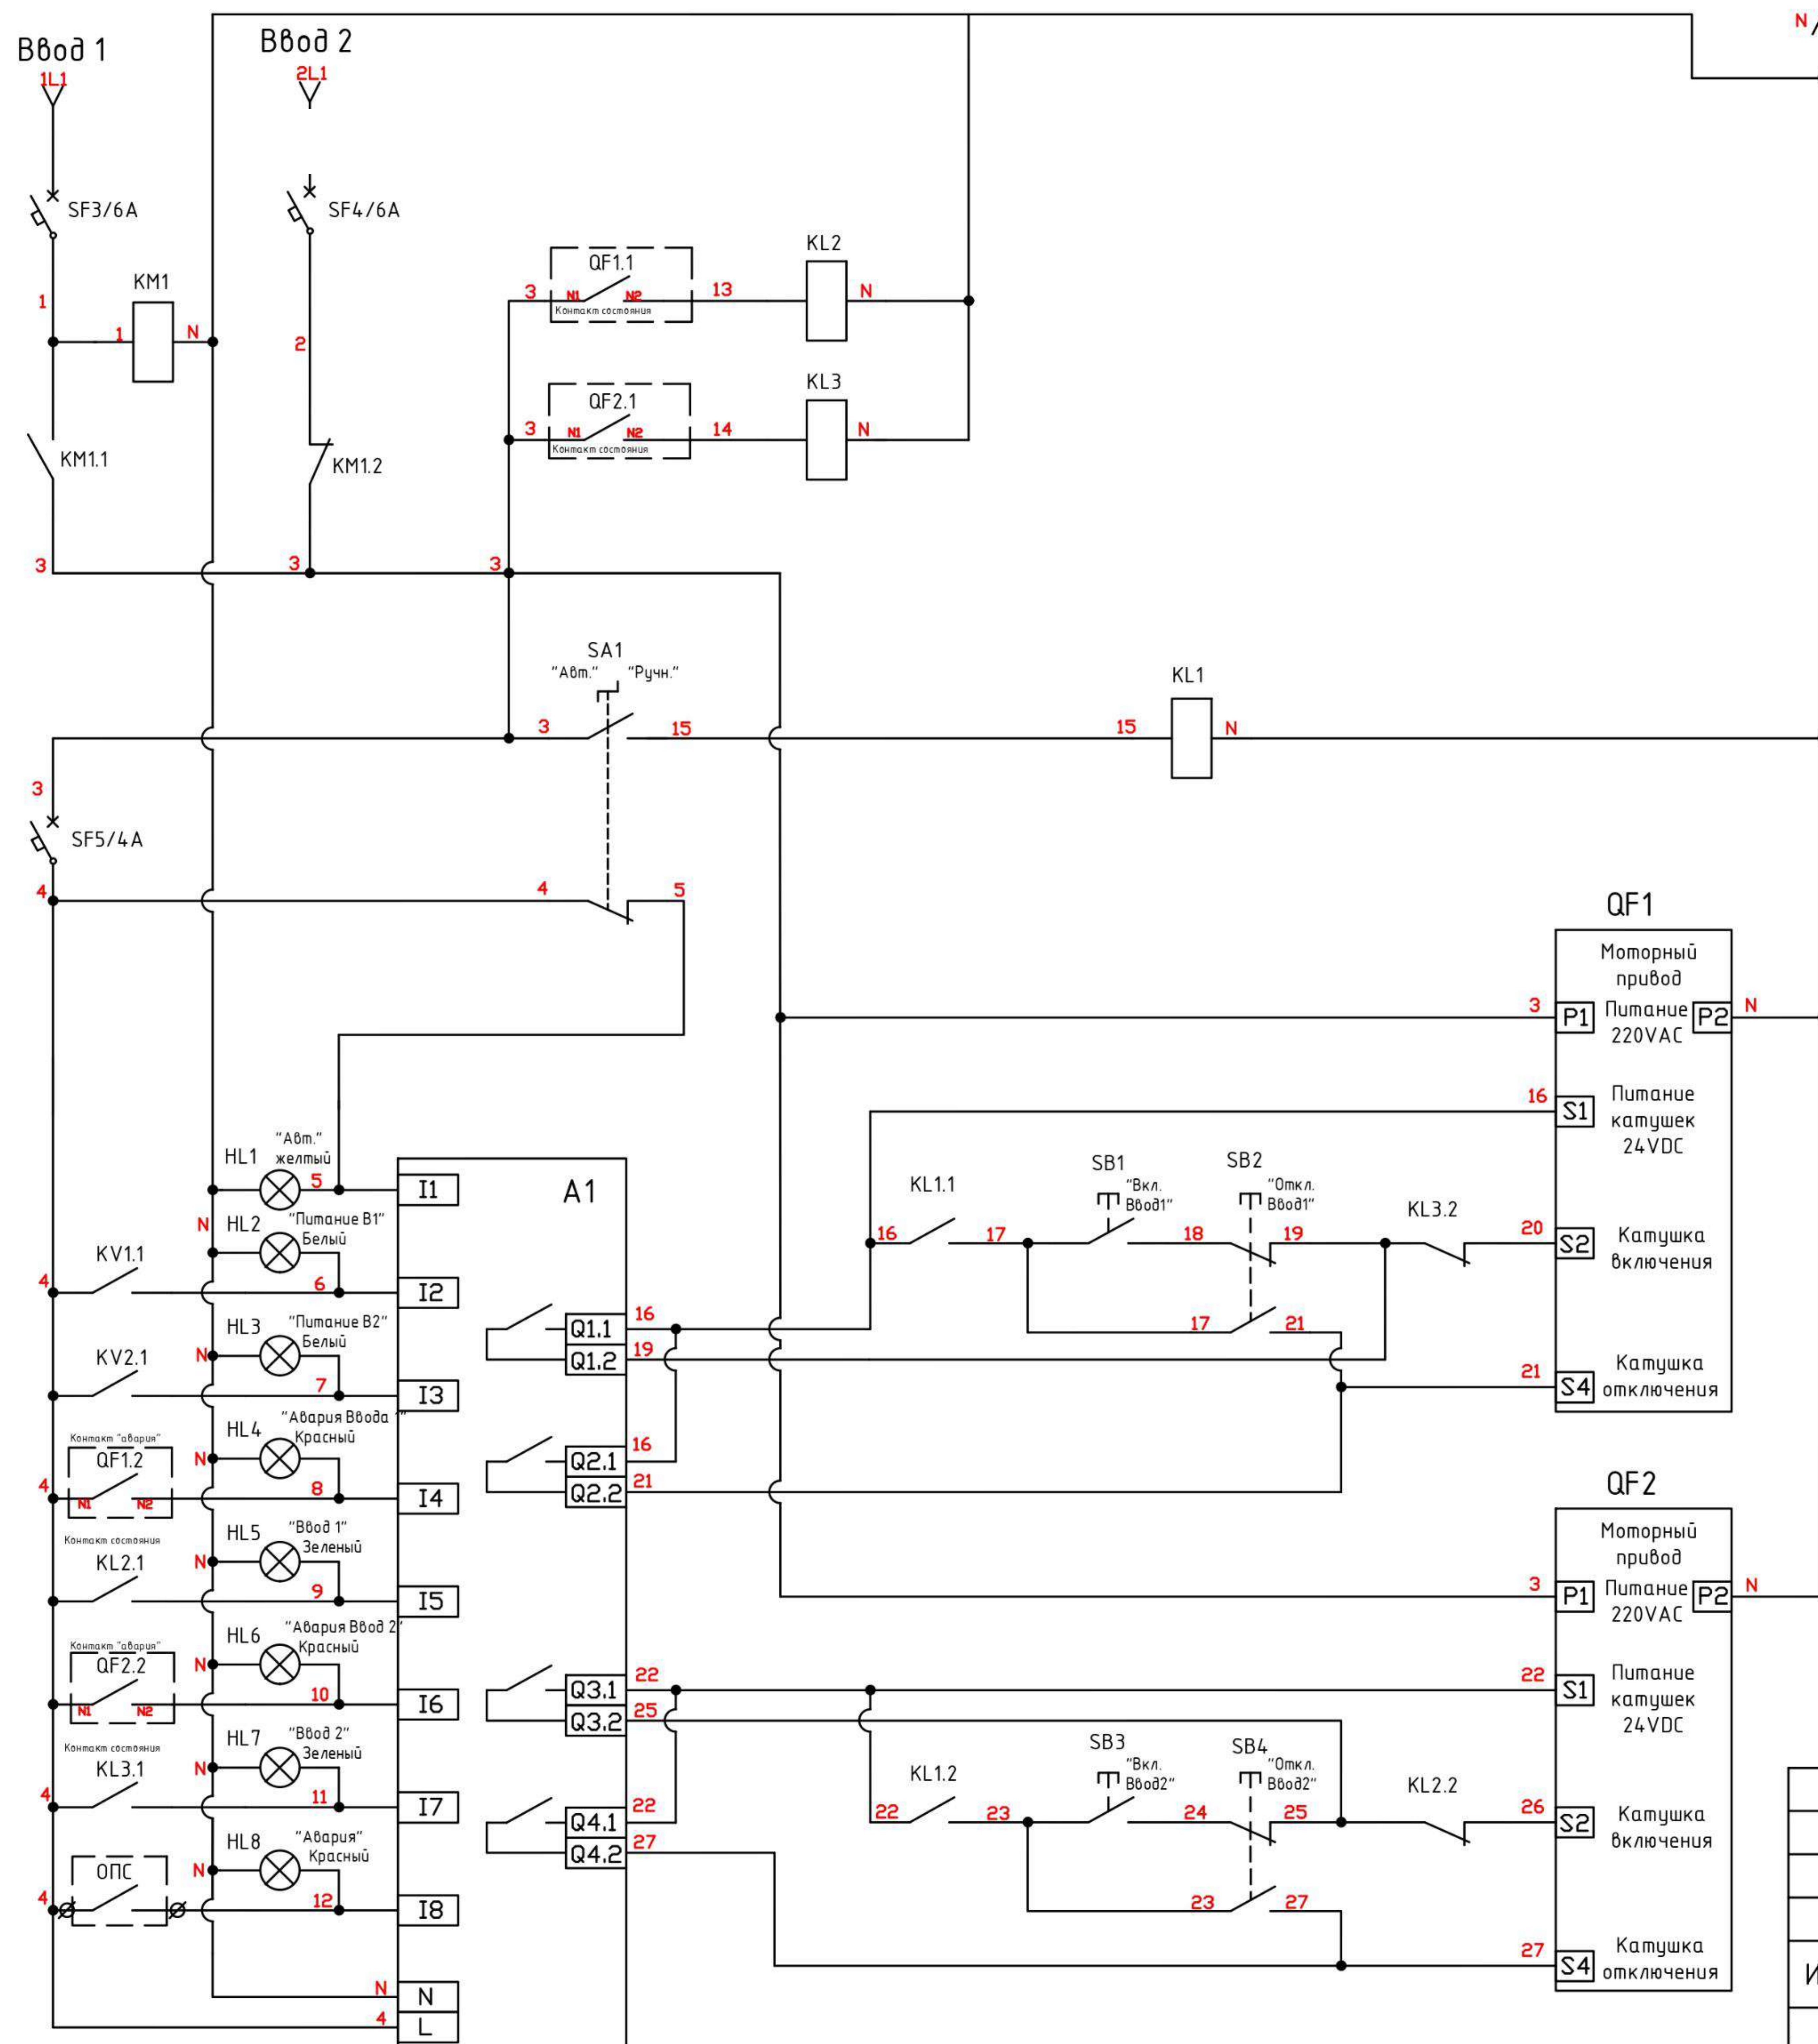

N	Состояние питающей сети	Положение автоматов	
		QF1	QF2
1	На вводе 1 и 2 есть питание	Вкл.	Откл.
2	На вводе 1 нет питания	Откл.	Вкл.
3	На вводе 2 нет питания	Вкл.	Откл.

ЛМШЕ.8244-03.25

						ЛМШЕ.8244-03.25			
Изм.	Кол.Уч	Лист	№ док	Подп.	Дата				
					03.25	АВР-PRS-A-2-1-1000	Стадия	Лист	Листов
					03.25			5	1
						Схема электрическая принципиальная			
				03.25					